



GENERAL INFORMATION:


PROJECT ID | 1618MS
PROJECT NAME | **16-18 Mill Street**
BUILDING ADDRESS | **16-18 Mill Street**
 | **Halton Hills, Ontario**

TESTED BY: AA/RS
DATE | **Apr 20-23**
TIME | **1:00:00 PM**

WATER MAIN INFORMATION:

MAIN SIZE / MATERIAL |
CONFIGURATION | **Looped**

HYDRANT LOCATION:

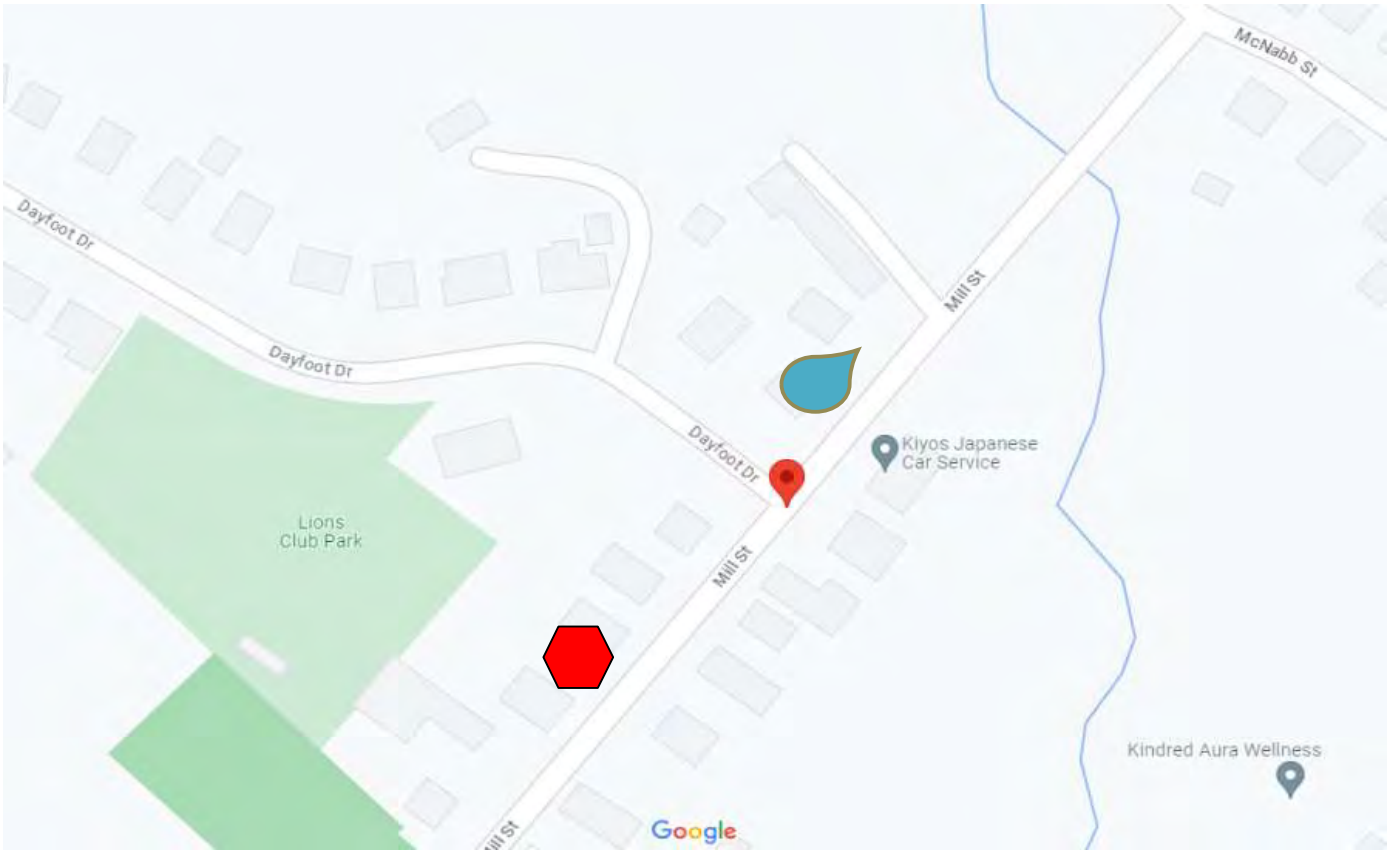

LEGEND:



STATIC HYDRANT



RESIDUAL HYDRANT

FINAL RESULTS:

Test #	Number of Outlets	Orifice Size (in)	Pitot Reading (psig)	Equivlnt Flow (usgpm)	Total Flow (usgpm)	Projected flow at 20psi (usgpm)	Gauge Pressure (psig)	Discharge Coef'nt
Static	N/A	N/A	N/A	N/A	0	N/A	80	N/A
1	1	2.47	62	1146	1146	4948	76	0.8
2	2	2.47	40	921	1842	5467	72	0.8

